

FIG. 2

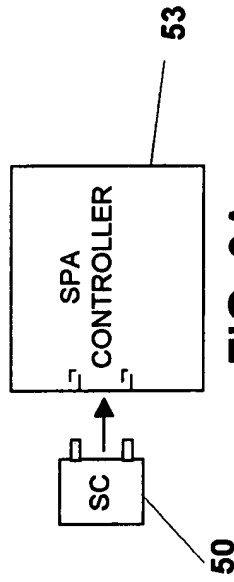


FIG. 3A

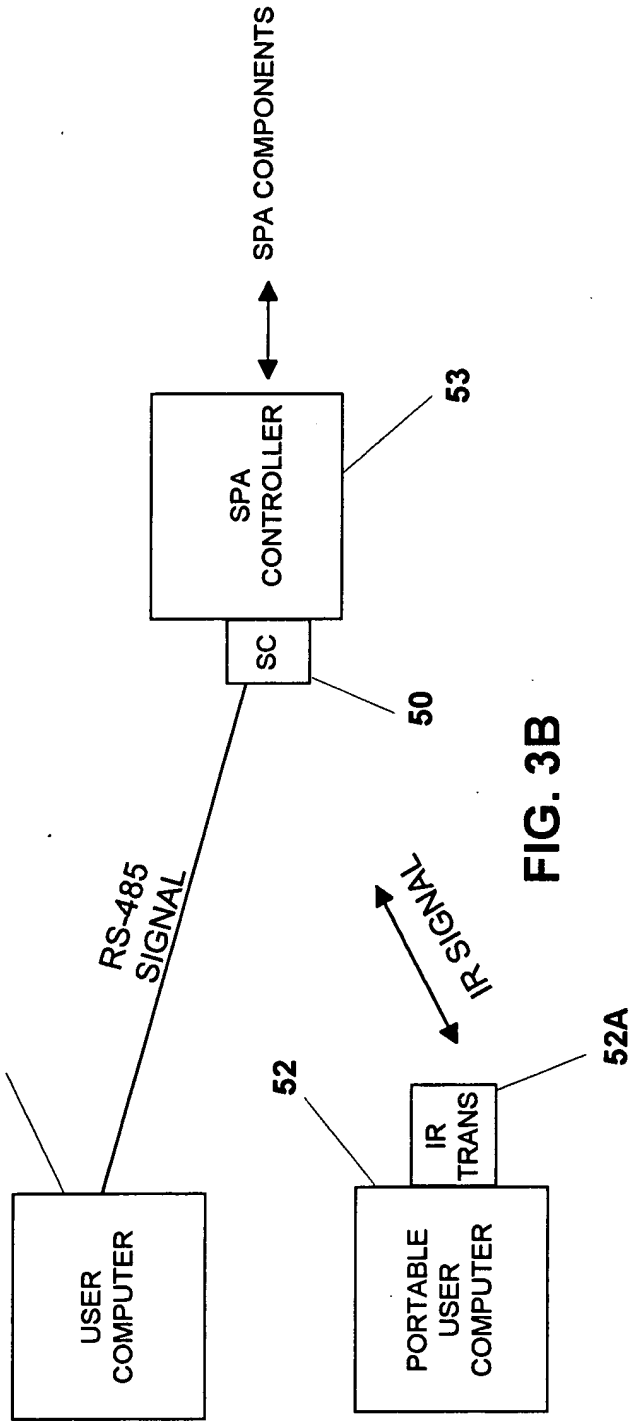
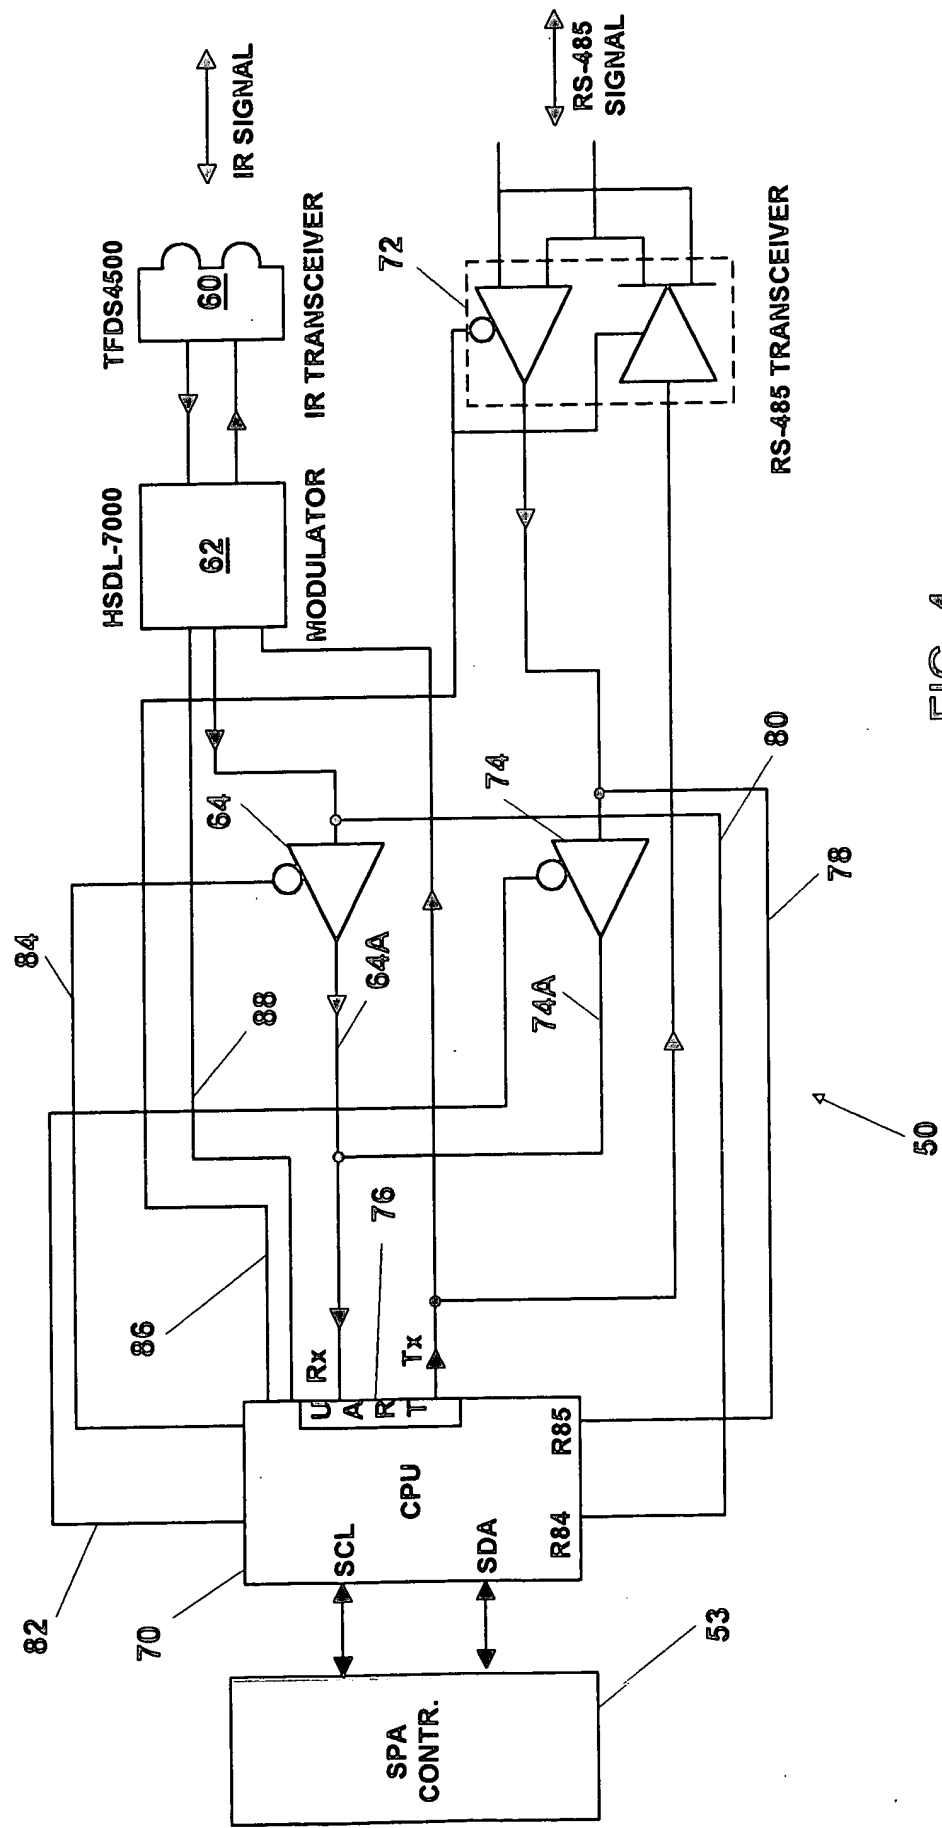


FIG. 3B

06709287-110700



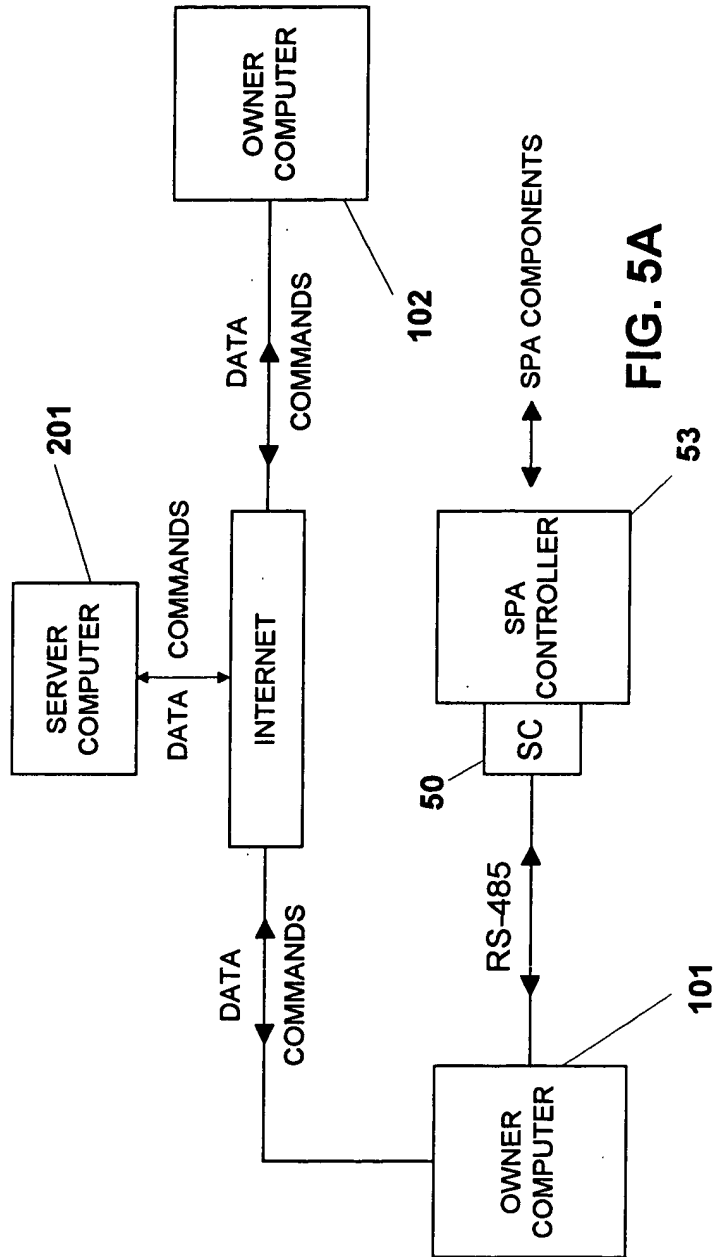


FIG. 5A

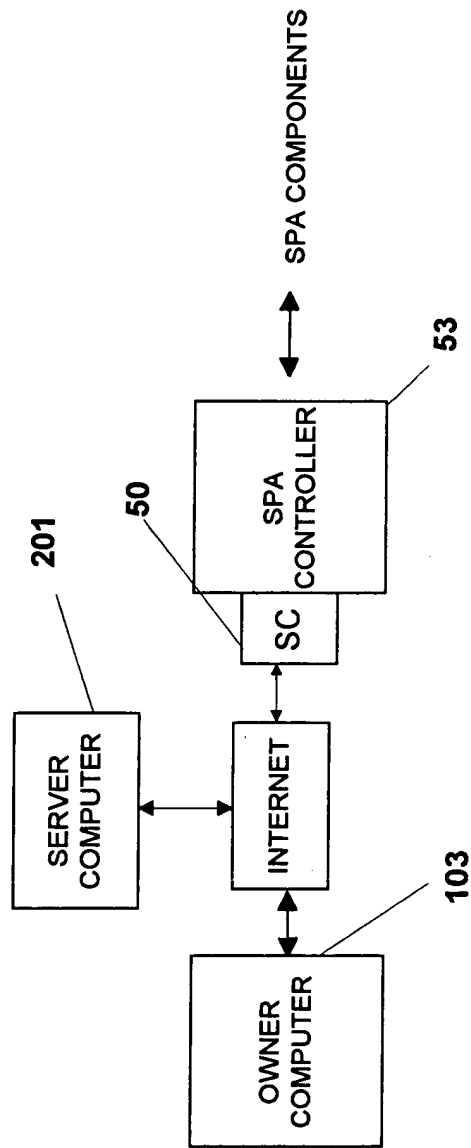


FIG. 5B

002077 28260460

WATER PUMP 1P: ON, HIGH SPEED ↓

WATER PUMP 2P: OFF ↓

WATER PUMP 3P: NOT INSTALLED ↓

AIR BLOWER: ON, MEDIUM SPEED ↓

CIRCULATION PUMP: NOT INSTALLED ↓

OZONATOR: OFF

LIGHT 1L: ON, LOW INTENSITY ↓

LIGHT 2L: NOT INSTALLED ↓

AUXILIARY 1A: OFF ↓

OWNER PAGE

CURRENT TIME: 01:38 PM

SET POINT: 102

☒ F
☐ C


WATER TEMP: 98

HEATER OFF


ERROR ON DISPLAY: PRESSURE SWITCH OPEN

PLUMBING FREEZE: LOW DANGER

PUMP, BLOWER TIMEOUT:

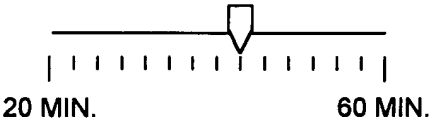

LIGHT TIMEOUT

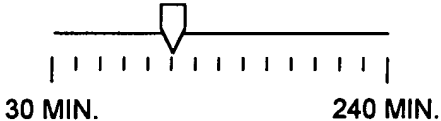

UPDATE INFO

QUIT

FIG. 6

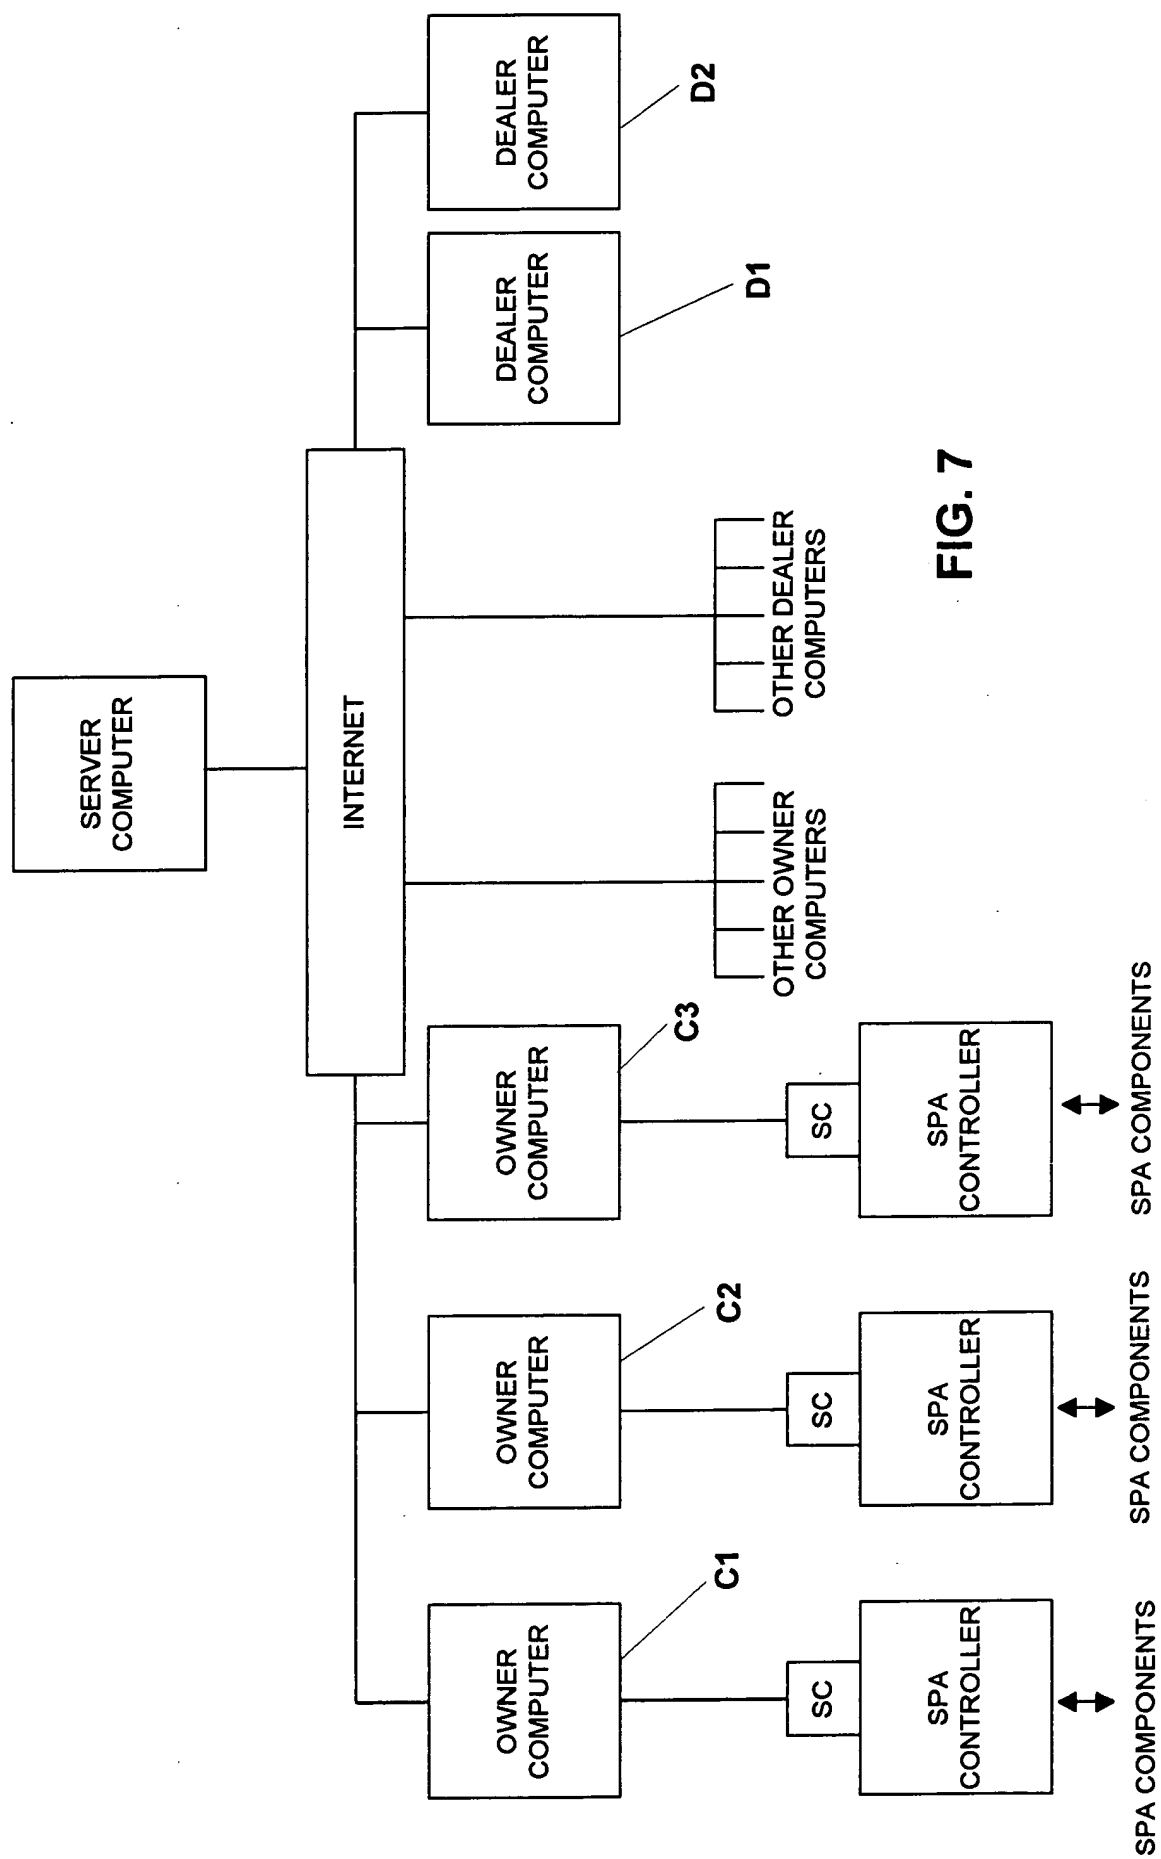


FIG. 7

DEALER PAGE

SOFTWARE:

9936-100148, REV.B

SEND NEW SOFTWARE TO
SPA...

152

153

TROUBLE SHOOTING
SECTION:

NUMBER OF TIMES SPA
RESET:

150

154

RESET ERROR LOG

156

ERROR LOG:

ERROR	TIME	DAYS SINCE	
HIGH LIMIT	04:32 AM	3	↑
FLOW OPEN	01:48 PM	5	
			↓

NUMBER OF TIMES ERRORS OCCURED:

HIGH LIMIT:

1

FREEZE:

0

PRESSURE SWITCH STUCK OPEN:

2

PRESSURE SWITCH STUCK CLOSED:

0

TEMPERATURE PROBE PROBLEM:

3

OVERHEAT:

0

FIG. 8

SPA HOURS OF OPERATION
SINCE LAST SERVICE:



279 HOURS

155

UPDATE INFO

QUIT

004077 28260250

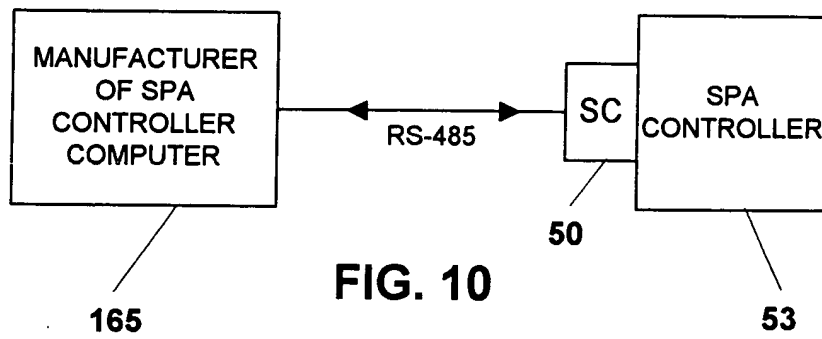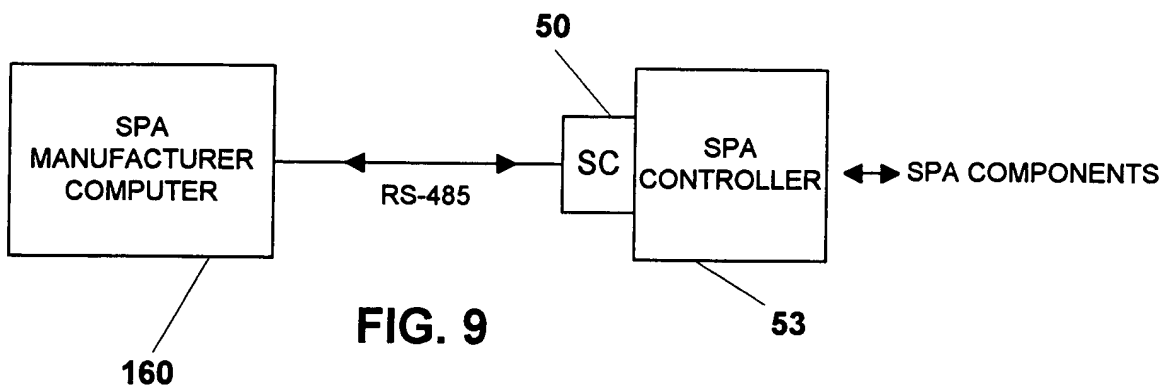

SPA
MANUFACTURER
PAGE

WATER PUMP 1P:	<table border="1"><tr><td>2-SPEED</td><td>↓</td></tr></table>	2-SPEED	↓	LOW SPEED:	<table border="1"><tr><td>6</td></tr></table>	6	AMPS	HIGH SPEED:	<table border="1"><tr><td>11</td></tr></table>	11	AMPS
2-SPEED	↓										
6											
11											
WATER PUMP 2P:	<table border="1"><tr><td>1-SPEED</td><td>↓</td></tr></table>	1-SPEED	↓	LOW SPEED:	<table border="1"><tr><td>6</td></tr></table>	6	AMPS	HIGH SPEED:	<table border="1"><tr><td>11</td></tr></table>	11	AMPS
1-SPEED	↓										
6											
11											
WATER PUMP 3P:	<table border="1"><tr><td>NOT INSTALLED</td><td>↓</td></tr></table>	NOT INSTALLED	↓		<table border="1"><tr><td>0</td></tr></table>	0	AMPS				
NOT INSTALLED	↓										
0											
AIR BLOWER:	<table border="1"><tr><td>3-SPEED</td><td>↓</td></tr></table>	3-SPEED	↓		<table border="1"><tr><td>6</td></tr></table>	6	AMPS				
3-SPEED	↓										
6											

HEATER ELEMENT:

23

 AMPS
MAX DRAW IN LC:

30

 AMPS
MAX DRAW IN HC:

50

 AMPS

QUIT

FIG. 11

004077" 29260260

SPA CONTROLLER
MANUFACTURER
PAGE

MIN. SET POINT: 59 F

MAX. SET POINT: 104 F

REGULATION OVERTEMP THRESHOLD: 112 F

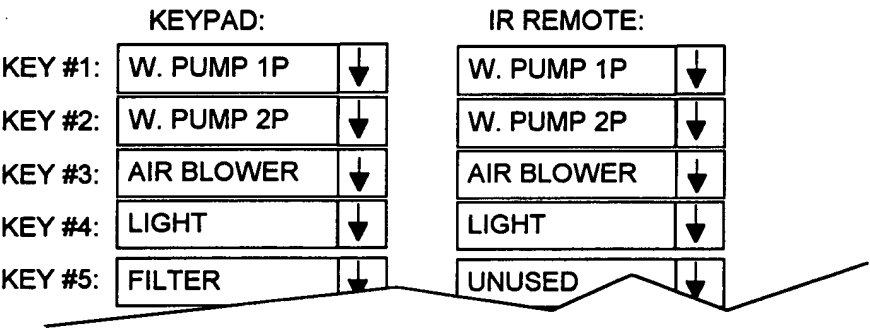


FIG. 12

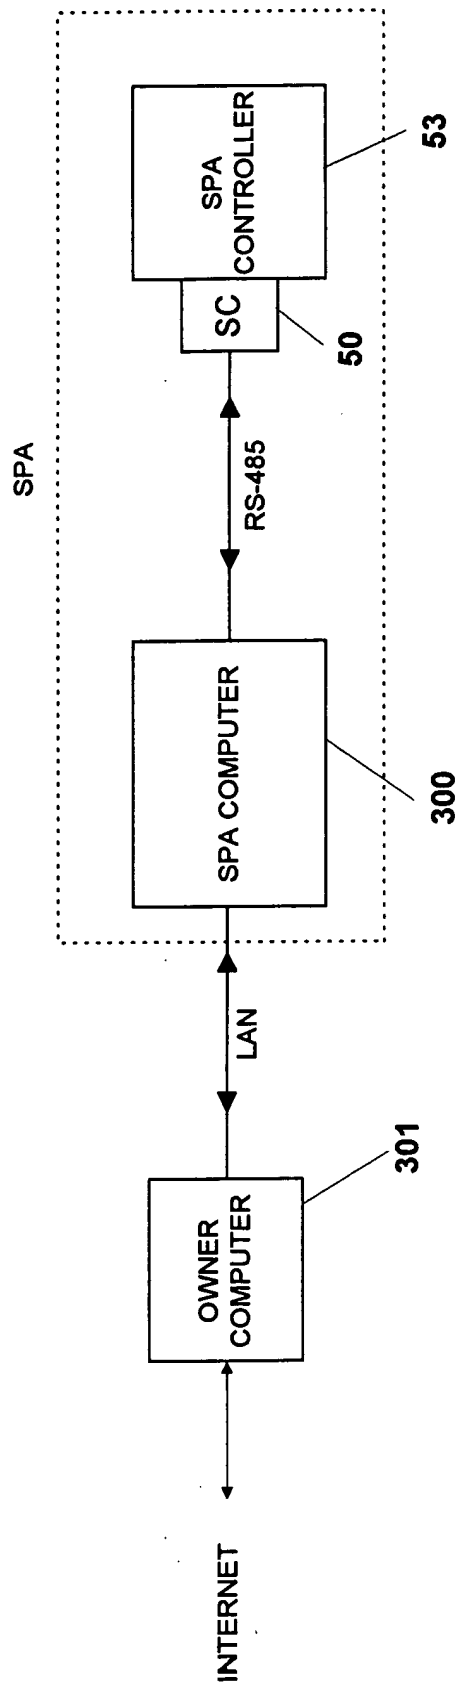


FIG. 13

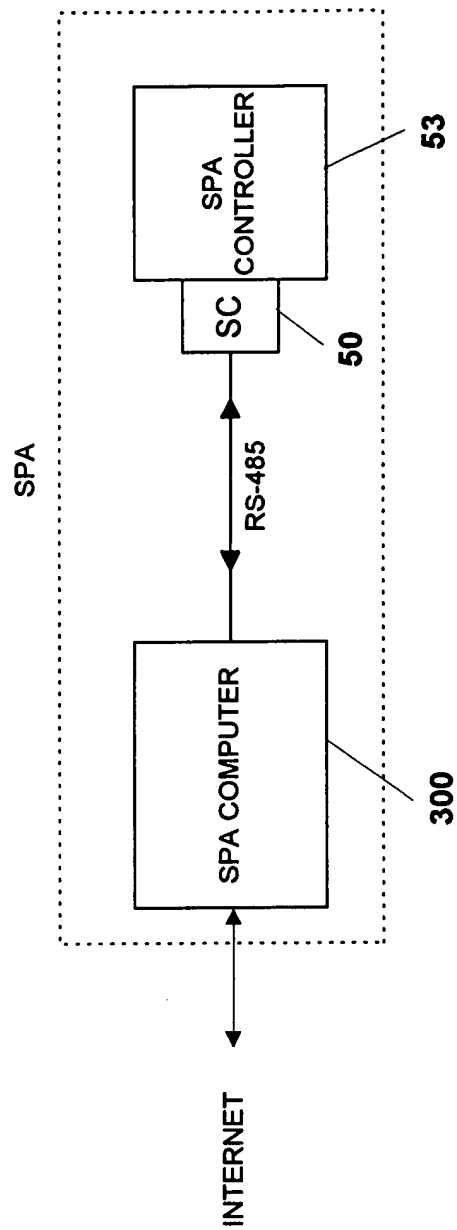


FIG. 14